

FEATURES

- 5" full-color capacitive touch panel (480x854 pixels)
- Available colour, please refer to: <https://www.zennio.com/finishes>
- 16 million color LCD display
- Proximity and luminosity sensor
- Loudspeakers for acoustic notifications
- 2 independent thermostats
- Optional features according to the license type (sold separately): Remote control from app, voice control, video intercom and internal calls
- Video intercom / IP camera compatibility: P2P SIP; G722/G721/G711u (PCMU) audio codecs; H264 video codec; DTMF (RFC 2833); mjpeg
- 2 analog/digital inputs
- Built-in temperature probe
- External 24-29 VDC power supply
- Micro-USB connection for firmware update and additional functionalities
- Ethernet connection
- Clock with NTP support
- Total data saving on KNX bus failure
- Integrated KNX BCU (TP1-256)
- Dimensions 142.1 x 85.5 x 35 mm (it protrudes 12 mm from the wall)
- Flush mount on back box
- Conformity with the CE, RCM directives (marks on the back side)

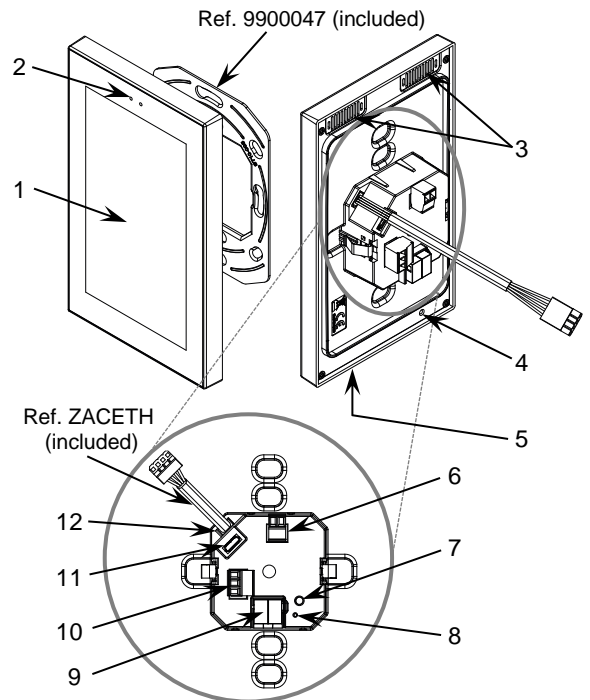


Figure 1: Z50

| | | | |
|------------------|------------------------------------|-------------------------|------------------------|
| 1. Touch screen | 2. Luminosity and proximity sensor | 3. Loudspeakers | 4. Temperature probe |
| 5. Microphone | 6. Power input | 7. Programming button | 8. Programming LED |
| 9. KNX connector | 10. Inputs connector | 11. Micro-USB connector | 12. Ethernet connector |

Programming button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode.

Programming LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it emits a red flash.

GENERAL SPECIFICATIONS

| CONCEPT | | DESCRIPTION | | |
|-------------------------------|---------------------|---|-----|-------|
| Type of device | | Electric operation control device | | |
| KNX supply | Voltage (typical) | 29 VDC SELV | | |
| | Voltage range | 21-31 VDC | | |
| | Maximum consumption | Voltage | mA | mW |
| | | 29 VDC (typical) | 4.6 | 133.4 |
| 24 VDC ¹ | 10 | 240 | | |
| Connection type | | Typical TP1 bus connector for 0.8 mm Ø rigid cable | | |
| External power supply | | 24-29 VDC. Maximum consumption: 225 mA (24 VDC) - 200 mA (29 VDC). Consumption without video intercom functionality: 160 mA (24 VDC) - 130 mA (29 VDC). | | |
| Operation temperature | | 5 .. +45 °C | | |
| Storage temperature | | -20 .. +55 °C | | |
| Operation humidity | | 5 .. 95% | | |
| Storage humidity | | 5 .. 95% | | |
| Complementary characteristics | | Class B | | |
| Protection class | | III | | |
| Operation type | | Continuous operation | | |
| Device action type | | Type 1 | | |
| Electrical stress period | | Long | | |
| Degree of protection | | IP20, clean environment | | |
| Installation | | With flush-mounted back box and fixing through pressure clips | | |
| Minimum clearances | | Not required | | |
| Response on KNX bus failure | | Data saving according to parameterization | | |
| Response on KNX bus restart | | Data recovery according to parameterization | | |
| Operation indicator | | The programming LED indicates programming mode (red). Backlighting of the display depending on the parameterization. | | |
| Weight | | 167 g | | |
| Housing material | | PC+ABS FR V0 halogen free | | |

¹ Maximum consumption in the worst-case scenario (KNX Fan-In model).

| INPUTS SPECIFICATIONS AND CONNECTIONS | |
|---------------------------------------|---|
| CONCEPT | DESCRIPTION |
| Number of inputs | 2 |
| Inputs per common | 2 |
| Operation voltage | 3.3 VDC in the common |
| Operation current | 1 mA @ 3.3 VDC (per input) |
| Switching type | Dry voltage contacts between input and common |
| Connection method | Pluggable screw terminal block (0.3 Nm max.) |
| Cable cross-section | 0.2-1 mm ² (IEC) / 26-16 AWG (UL) |
| Maximum cable length | 30 m |
| NTC accuracy (@ 25 °C) ² | ±0.5 °C |
| Temperature resolution | 0.1 °C |
| Maximum response time | 10 ms |

² For Zennio temperature probes.

INPUTS CONNECTION


Any combination of the following accessories is allowed in the inputs:

Temperature Probe**




⚠ Commons of different devices must not be connected together.

Motion Sensor



Screw terminal for Zennio motion sensors*

Switch/Sensor/ Push button



* In case of using ZN110-DETEC-P sensor, its micro switch number 2 must be in **Type B position**.


** Zennio temperature probe or any NTC with known resistance values at three points in the range [-55, 150 °C].

| EXTERNAL POWER SUPPLY AND PORTS SPECIFICATIONS AND CONNECTIONS | |
|--|--|
| CONCEPT | DESCRIPTION |
| Voltage | 24-29 VDC |
| Current | 225 mA (24 VDC) - 200 mA (29 VDC) |
| Connection method | Pluggable screw terminal block (0.3 Nm max.) |
| Cable cross-section | 0.2-1 mm ² (IEC) / 26-16 AWG (UL) |
| USB connector | Micro USB Type B connector. Use it only for the functionality specified in the manual. Do not connect neither to PC, hard drives nor other devices whose consumption is over 150 mA. The information about the underlying software licenses can be downloaded through the USB port by connecting a flash memory drive containing an empty folder named Z50_LICENSE |
| Ethernet Connector | Pluggable connector for 4-wire push-in connection |

| INTERNAL TEMPERATURE SENSOR SPECIFICATIONS | |
|--|--|
| CONCEPT | DESCRIPTION |
| Measuring range | -10 °C .. 50 °C |
| NTC accuracy (@ 25 °C) ² | ±0.5 °C |
| Temperature resolution | 0.1 °C |
| Calibration | The temperature sensor should be calibrated through the application program. Moreover, to avoid fluctuations in the temperature measurement, the flush-mounted box must be completely sealed once the cables are inside. Airtight boxes, polyurethane foam, silicone rubber or similar non-breathable construction materials can be used. It is not recommended to use this temperature sensor for a thermostatic control. |

INSTALLATION INSTRUCTIONS

1. Fix the metal plate into a back box by using the screws from the box, checking that it is levelled.
2. Connect the KNX bus, the power supply, the inputs and the Ethernet cable (inserting each 4 mm stripped wire, according to the colors indicated on the connector), to the back of the device. Minimize the length of excess cable inside the back box to facilitate the installation.
3. Fit the device into its final position and check that the strength of the clips is enough to fix the device. Check that the metal plate is completely hidden by the device.

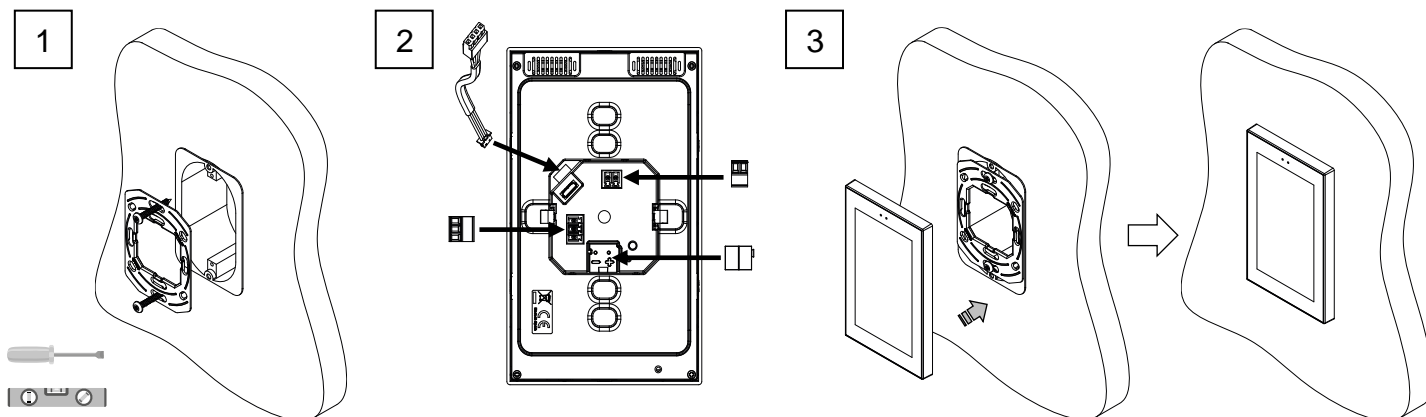

NOTE: During the device start-up, please select the option to *postpone* the acceptance of the EULA legal agreement, thus transferring it to the end user.

MAINTENANCE INSTRUCTIONS

- Do not use aerosol sprays, solvents, or abrasives that might damage the device.
- Clean the product with a clean, soft, damp cloth.

SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at <https://www.zennio.com/en/legal/weee-regulation>.
- This device contains software subject to specific licences. For details, please refer to <https://zennio.com/licenses>.